


THIS BOOTH IS PROVIDED COMPLETE FROM MANUFACTURER (PART # 1468 (EXTENDED TO 18'-5\"/>

1. WATER CLOSET SINK AND WATER HEATER ARE SHIPPED LOOSE FOR CONNECTION IN FIELD.
2. SEWER AND WATER ARE TO CONNECT AS INDICATED. ADD INSULATION TO LAVATORY SUPPLIES AND DRAIN.
3. WATER HEATER IS TO PLUG INTO DEDICATED RECEPTACLE INCLUDED BY MANUFACTURER.
4. MANUFACTURER IS TO INCLUDE WALL HEATERS, EXHAUST FAN AND ROOF MOUNTED AIR CONDITIONING UNIT COMPLETE WITH CONTROLS.
5. ELECTRICAL CONTRACTOR SHALL CONNECT NEW PANEL PROVIDED BY MANUFACTURER. BOOTH CONTAINS ALL RECEPTACLES AND LIGHTS SHOWN AND BRANCH CIRCUITS TO ALL DEVICES. CONTRACTOR TO INSTALL AND CONNECT BUILDING GROUND AND VERIFY ALL FIXTURES, LAMPS ETC. ARE IN PLACE AS SHOWN. EXTERIOR LIGHT TO INCLUDE FLUORESCENT LAMP.

1
GUARD STATION
EXPANDED FLOOR
PLAN - ELECTRICAL
E-4 SCALE: 1/4" = 1'-0"

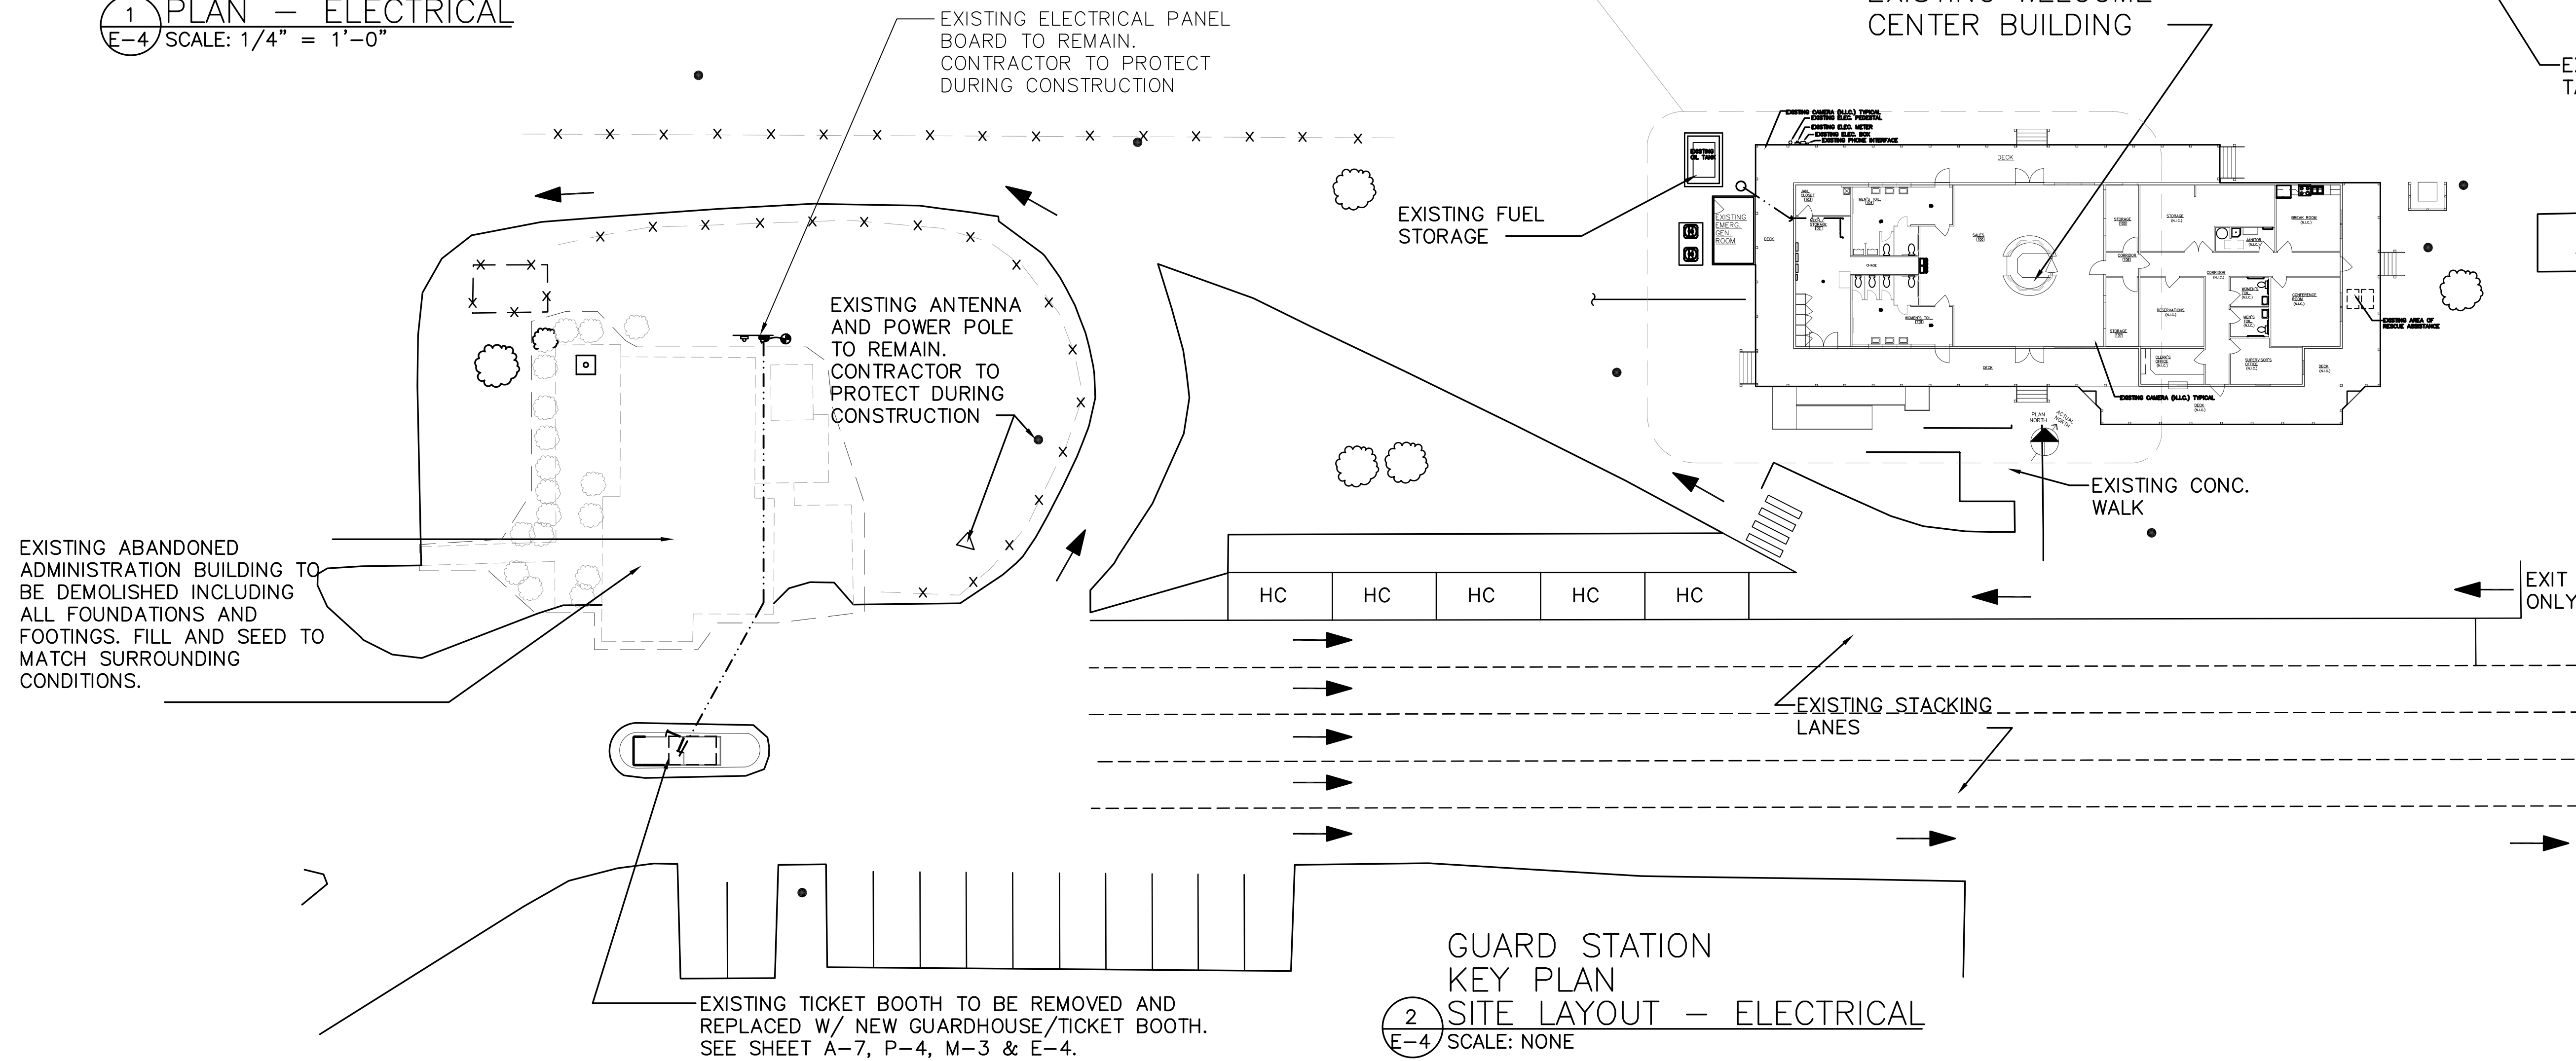

2
GUARD STATION
KEY PLAN
SITE LAYOUT - ELECTRICAL
E-4 SCALE: NONE

WATTAGE SUMMARY

LIGHTING : 111 S.F. X 3-1/2 V-A/S.F. X 1.25	486 V-A
RECEPTACLES : 2 @ 180 V-A/REC.	360 V-A
WATER HEATER:	1,500 V-A
SIGN CIRCUIT:	1,500 V-A
FUTURE:	1,000 V-A
H.V.A.C. :	
FANS : (ESTIMATED)	100 V-A
HEATERS:	5,500 V-A
AIR CONDITIONER:	1,628 V-A
	12,074 V-A

12,074 V-A
240V = 50.3 AMPS

